


CORED OPENINGS SHALL BE BEVELLED TO ALLOW FOR MIS-ALIGNMENT.
 FLEXIBLE SLEEVE SHALL BE NEOPRENE MATERIAL MEETING ASTN C-443.
 VOIDS BETWEEN GASKET AND STRUCTURE SHALL BE FILLED USING TYPE
 N MORTAR AND FINISHED SMOOTH.



MNDOT SPEC. REF. 2503, 2506
 MNDOT 4007C
 NOT TO SCALE

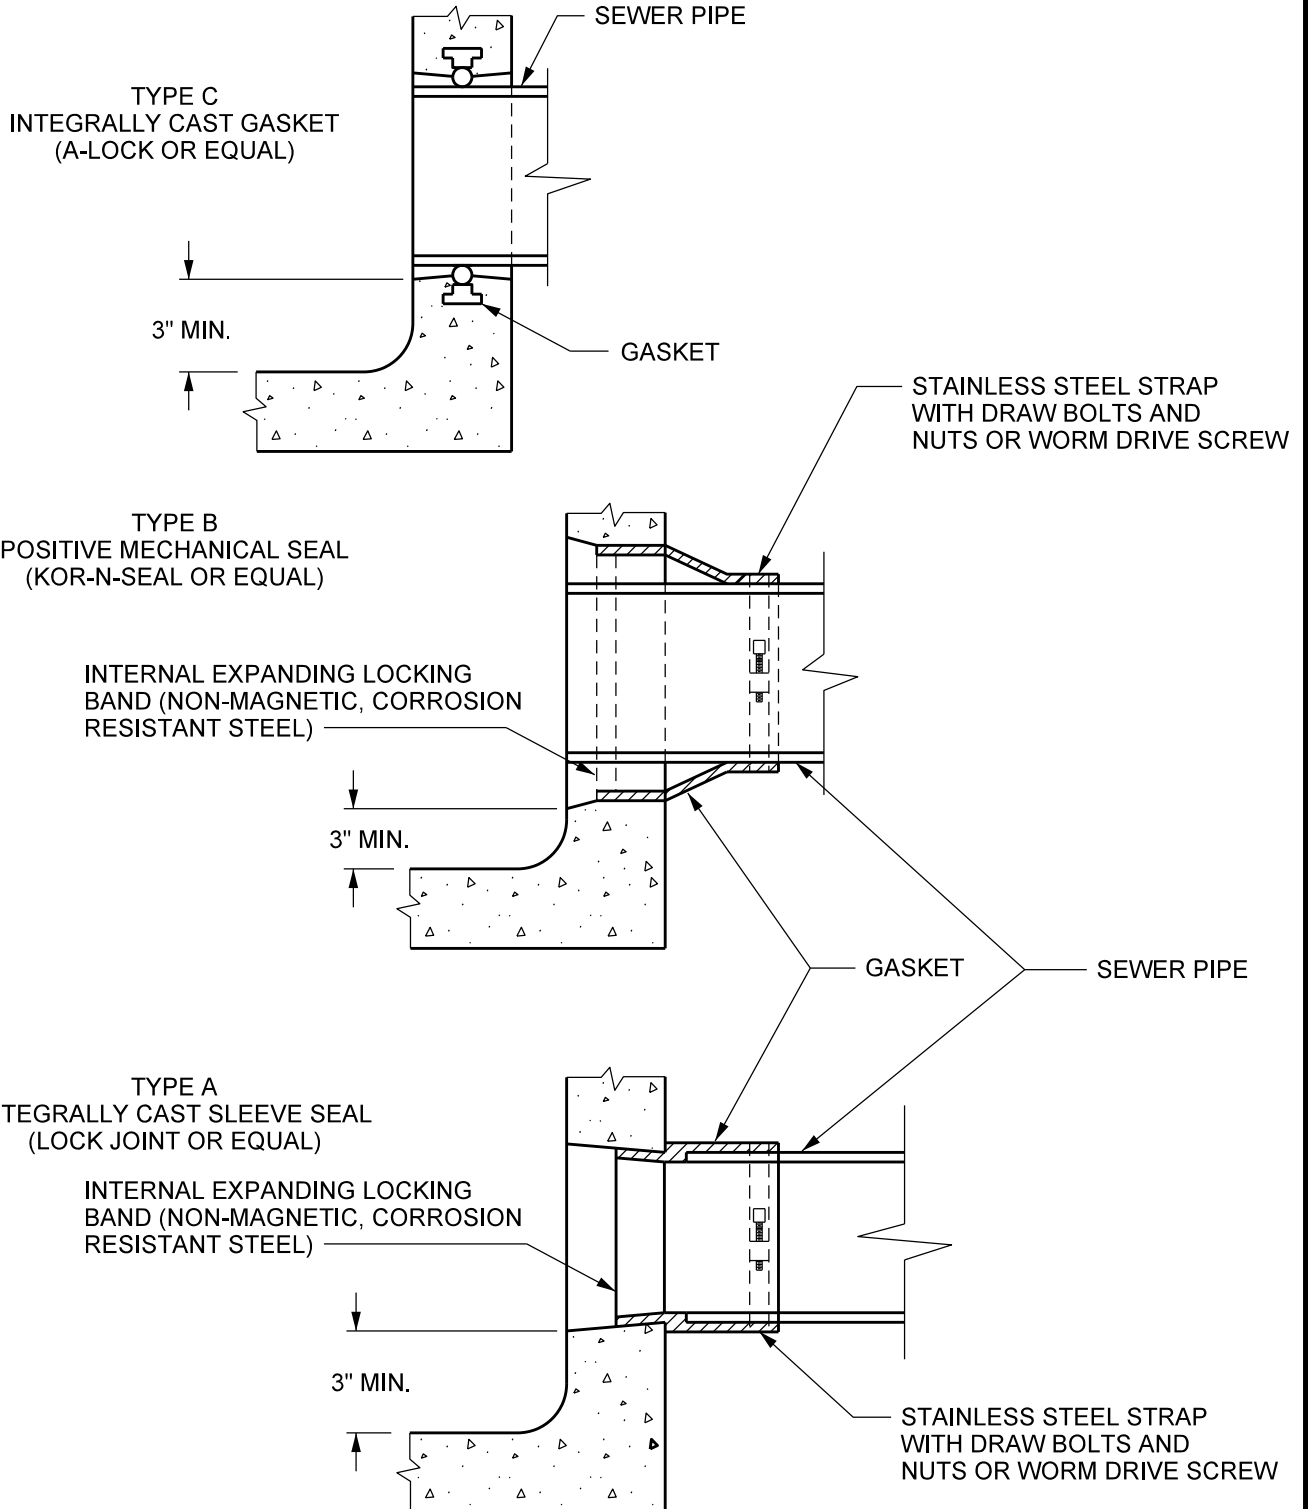

DRW: DCD

DATE: 3/03

APP: HRS

DATE: 12/06

WATERTIGHT PIPE CONNECTION

STANDARD
 PLATE
 NO.
 SEWR-3001